

ANALYSIS OF FINNED HEAT PIPES HEAT EXCHANGERS USING THE THERMAL EFFICIENCY METHOD: IFHPHE VERSUS AFHPHE

ANÁLISE DE TROCADORES DE CALOR COM TUBOS DE CALOR ALETADOS UTILIZANDO O MÉTODO DA EFICIÊNCIA TÉRMICA: IFHPHE VERSUS AFHPHE

ANÁLISIS DE INTERCAMBIADORES DE CALOR CON TUBOS DE CALOR ALETADOS UTILIZANDO EL MÉTODO DE EFICIENCIA TÉRMICA: IFHPHE VERSUS AFHPHE



<https://doi.org/10.56238/edimpacto2025.086-006>

Élcio Nogueira¹, Quezia Manuela Gonçalvez Laurindo², Maria Victoria Cabrera Aguilera³, Alvaro H. Pereira⁴

ABSTRACT

This work compares two heat exchangers that use finned heat tubes: a crossflow finned tube heat exchanger with individual fins (IFHPHE) and an axially finned tube heat exchanger with parallel flow in the evaporator and counterflow in the condenser (AFHPHE). The IFHPHE heat exchanger was designed and experimentally implemented to operate in small air conditioning systems with air flow rates in the range of 300 to 500 m³/h. The AFHPHE heat exchanger is in the theoretical design phase and has the potential to be used in air conditioning systems for operating rooms of 60 m³, with an air flow rate of 0.20 kg/s. The method used for theoretical comparisons between heat exchangers is the thermal efficiency method, and the main quantities obtained for comparison are velocities, Nusselt numbers, thermal effectiveness, air outlet temperatures, pressure drops, and Bejan numbers in the evaporator, condenser, and heat exchanger. The working fluid used is refrigerant R404a. The saturation temperature is 17.0 °C, with a fixed number of fins for both heat exchangers, equal to 30 fins, and 49 heat pipes as standard. Comparisons demonstrate superior thermal performance and very similar viscous performance when AFHPHE is compared to IFHPHE with 30 fins. When the simulations consider 70 fins for the IFHPHE, the thermal performances are very close to those of the AFHPHE with 30 fins. However, in this last case, with 70 fins, the viscous performance is very high and should not be implemented in real-world situations.

Keywords: Heat Pipes Heat Exchangers. Individually Finned Heat Tubes (IFHPHE). Axially Finned Heat Tubes (AFHPHE). Thermal Efficiency Method. Viscous Performance. Bejan Number.

¹ Universidade do Estado do Rio de Janeiro (DME/FAT/UERJ). Rio de Janeiro, Brazil.
E-mail: elcionogueira@uerj.br Orcid: <https://orcid.org/0000-0003-3253-5280>

² Universidade do Estado do Rio de Janeiro (DME/FAT/UERJ). Rio de Janeiro, Brazil.
Orcid: <https://orcid.org/0000-0002-9086-4595>

³ Universidade do Estado do Rio de Janeiro (DME/FAT/UERJ). Rio de Janeiro, Brazil.
Orcid: <https://orcid.org/0000-0003-3832-3967>

⁴ Universidade do Estado do Rio de Janeiro (DME/FAT/UERJ). Rio de Janeiro, Brazil.
Orcid: <https://orcid.org/0009-0006-8874-5120>

RESUMO

Este trabalho compara dois trocadores de calor que utilizam tubos de calor aletados: um trocador de calor de tubos aletados em escoamento cruzado com aletas individuais (IFHPHE) e um trocador de calor de tubos aletados axialmente com escoamento paralelo no evaporador e contracorrente no condensador (AFHPHE). O trocador de calor IFHPHE foi projetado e implementado experimentalmente para operar em sistemas de ar-condicionado de pequeno porte, com vazões de ar na faixa de 300 a 500 m³/h. O trocador de calor AFHPHE encontra-se em fase de projeto teórico e apresenta potencial para ser utilizado em sistemas de ar-condicionado para salas cirúrgicas de 60 m³, com vazão de ar de 0,20 kg/s. O método utilizado para as comparações teóricas entre os trocadores de calor foi o método da eficiência térmica, e as principais grandezas obtidas para comparação foram velocidades, números de Nusselt, efetividade térmica, temperaturas de saída do ar, perdas de carga e números de Bejan no evaporador, no condensador e no trocador de calor. O fluido de trabalho utilizado foi o refrigerante R404a. A temperatura de saturação foi de 17,0 °C, com número fixo de aletas para ambos os trocadores de calor, igual a 30 aletas, e 49 tubos de calor como configuração padrão. As comparações demonstram desempenho térmico superior e desempenho viscoso muito semelhante quando o AFHPHE é comparado ao IFHPHE com 30 aletas. Quando as simulações consideram 70 aletas para o IFHPHE, os desempenhos térmicos tornam-se muito próximos aos do AFHPHE com 30 aletas. Entretanto, neste último caso, com 70 aletas, o desempenho viscoso é muito elevado e não deve ser implementado em situações reais.

Palavras-chave: Trocadores de Calor com Tubos de Calor. Tubos de Calor com Aletas Individuais (IFHPHE). Tubos de Calor com Aletas Axiais (AFHPHE). Método da Eficiência Térmica. Desempenho Viscoso. Número de Bejan.

RESUMEN

Este trabajo compara dos intercambiadores de calor que utilizan tubos de calor aletados: un intercambiador de calor de tubos aletados en flujo cruzado con aletas individuales (IFHPHE) y un intercambiador de calor de tubos aletados axialmente con flujo paralelo en el evaporador y flujo a contracorriente en el condensador (AFHPHE). El intercambiador de calor IFHPHE fue diseñado e implementado experimentalmente para operar en sistemas de aire acondicionado de pequeño porte, con caudales de aire en el rango de 300 a 500 m³/h. El intercambiador de calor AFHPHE se encuentra en fase de diseño teórico y tiene el potencial de ser utilizado en sistemas de aire acondicionado para quirófanos de 60 m³, con un caudal de aire de 0,20 kg/s. El método utilizado para las comparaciones teóricas entre los intercambiadores de calor fue el método de eficiencia térmica, y las principales magnitudes obtenidas para la comparación fueron velocidades, números de Nusselt, efectividad térmica, temperaturas de salida del aire, pérdidas de carga y números de Bejan en el evaporador, el condensador y el intercambiador de calor. El fluido de trabajo utilizado fue el refrigerante R404a. La temperatura de saturación fue de 17,0 °C, con un número fijo de aletas para ambos intercambiadores de calor, igual a 30 aletas, y 49 tubos de calor como configuración estándar. Las comparaciones demuestran un desempeño térmico superior y un desempeño viscoso muy similar cuando el AFHPHE se compara con el IFHPHE con 30 aletas. Cuando las simulaciones consideran 70 aletas para el IFHPHE, los desempeños térmicos son muy cercanos a los del AFHPHE con 30 aletas. Sin embargo, en este último caso, con 70 aletas, el desempeño viscoso es muy elevado y no debería implementarse en situaciones reales.

Palabras clave: Intercambiadores de Calor con Tubos de Calor. Tubos de Calor con Aletas Individuales (IFHPHE). Tubos de Calor con Aletas Axiales (AFHPHE). Método de Eficiencia Térmica. Desempeño Viscoso. Número de Bejan.

1 INTRODUCTION

Two finned heat tube heat exchangers are compared. One of the heat exchangers in question, called Individually Finned Heat Tube Heat Exchanger (IFHPHE), was designed and implemented experimentally [1]. The second heat exchanger, called Axially Finned Heat Tube Heat Exchanger (AFHPHE), was developed and implemented theoretically using the Thermal Efficiency Method [2]. Both heat exchangers were designed for use in small air conditioning systems, with great potential for use in operating rooms.

Górecki, G. et al. [1] are dedicated to the modeling, design and experimental study of a heat tube heat exchanger used as a recuperator in small air conditioning systems (air flow $\approx 300\text{--}500 \text{ m}^3/\text{h}$), composed of heat tubes with individual fins (IFHPHE). The designed heat exchanger was built and tested on the experimental bench. The refrigerant R404A was chosen as the working fluid based on preliminary results. The heat exchanger implementation contains 20 rows of finned heat tubes in a staggered arrangement, with 49 heat tubes. The configuration was optimized to maximize efficiency (up to 66%) and minimize pressure drop (less than 150 Pa), and the experimental data showed a good level of agreement with the model — relative difference less than 10%.

Nogueira, É. et al. [2] implement a theoretical model with axially finned thermosiphons, aiming at thermal comfort in air conditioning systems. The idealized configuration uses as a reference a heat exchanger with a radial finned heat pipe, whose theoretical and experimental analysis is already well established [1]. They apply the thermal efficiency method to determine thermal quantities, and the second law of thermodynamics to determine thermal and viscous irreversibilities. They present numerical and graphical results for the physical quantities of velocities, Reynolds numbers, Nusselt numbers, convection heat transfer coefficients, number of thermal units, heat transfer rates, friction factors, pressure drops and Bejan number. The results demonstrate the expected physical consistency for all the quantities analyzed. They conclude that the developed model presents promising results and should be used in the experimental implementation of an air conditioning system for operating rooms.

Nandy Putra, Trisno Anggoro, Adi Winarta [3] state that hospital heating, ventilation and air conditioning systems consume large amounts of energy. They propose the use of high-pressure water heat exchangers (HPHEs) as an alternative to minimize consumption. They conduct experiments to investigate the performance of HPHEs consisting of several heat pipes with water as the working fluid, arranged in rows. They experimentally determined the effect of inlet air temperature, the effect of air velocity and the influence of the number of rows of heat pipes. They obtained results using six rows of high-pressure water heat exchangers (HPHEs), an air velocity of 1 m/s and an evaporator inlet air temperature of 45

°C. They demonstrate that the total energy consumption in the implemented air conditioning system, based on the annual heat recovery forecast for 8 h/day and 365 days/year, decreases significantly from 0.6 to 4.1 GJ/year.

Ragil Sukarno et al. [4] cite specific requirements related to thermal comfort that made it necessary to create heat recovery systems using a heat pipe exchanger (HPHE). They build an experimental apparatus with three, six, and nine rows of heat pipes, arranged in a staggered configuration. They use the ε -NTU method to predict the effectiveness, the evaporator-side outlet temperature, and the energy recovery of the HPHE. They find that the energy recovery of the HPHE increased with the number of rows, the air inlet temperature, and the air velocity in the evaporator section. They conclude that the ε -NTU method can be used for the analysis of heat recovery systems that apply air conditioning systems with HPHE.

Imansyah Ibnu Hakim, Ragil Sukarno, Nandy Putra [5] argue for the need to use heating, ventilation and air conditioning (HVAC) systems to reduce energy consumption in buildings. They present a study that aims to investigate the use of a U-shaped finned heat pipe heat exchanger (HPHE). They performed tests with single and double row configurations, arranged in eight heat pipes per row. The results show that the U-shaped heat pipe heat exchanger significantly affects the pre-cooling and reheating processes in the HVAC system. They state that the U-Shaped heat pipe proved to be a viable solution for HVAC systems that require cooling for reheating.

Élcio Nogueira [6] applies the thermal efficiency method to the theoretical analysis of the thermal performance of a finned heat pipe heat exchanger (FHPHE), used as an auxiliary device to control the temperature and quality of air conditioning in operating rooms. The theoretical analysis performed is point-by-point and distributed, divided into three aspects: analysis of the evaporator section, analysis of the condenser section, and analysis of the heat exchanger in terms of overall performance. It uses a theoretical-experimental study, which uses the concept of thermal effectiveness (ε -NTU) as a comparison object, and demonstrates that the localized theoretical-experimental comparisons are consistent, and the absolute relative error for the overall heat transfer rate varies from 0.5% to 35% for the heat exchanger under analysis.

Élcio Nogueira [7] applies a theoretical procedure to determine the performance of an individually finned heat exchanger (IFHPHE) used in an air conditioning system. The relevant variables used to determine the results are the number of fins per heat tube and the number of heat tube rows. A theoretical-experimental comparison demonstrates that the applied localized model can be used as a comprehensive design and analysis tool for finned heat exchangers. Results obtained for the Bejan number, which relates thermal and viscous

irreversibilities, show that fin numbers between 10 and 20 for 49 heat tubes provide a better cost-benefit ratio. The absolute percentage errors obtained between the theoretical and experimental values for the overall heat transfer rate and overall thermal efficiency range from 2.0% to 42.1%.

2 METHODOLOGY

Analytical solution using the Thermal Efficiency Method. A comparison was made between two specific types of finned heat exchangers. The theoretical formulations are explained through the expressions and equations below. When there is a difference in formulation between the heat exchangers under analysis, the representation for AFHPHE will be shown in red, and for IFHPHE in black.

The Thermal Efficiency Method, so named by Élcio Nogueira [...], based on work published by Ahamad Fakheri [...], has been used in many theoretical versus experimental comparisons in recent years. Thermal efficiency, obtained through an analogy of the thermal performance of finned systems, is the main quantity used to determine the thermal performance of heat exchangers. The effectiveness and rate of heat transfer of the heat exchanger are obtained from the thermal efficiency, since this physical quantity, like thermal effectiveness, measures the potential associated with the heat exchanger. Low thermal efficiency means that the heat exchanger has exhausted all its capacity for exchange between fluids and, in this sense, shows a tendency opposite to thermal efficiency.

The refrigerant used in simulations and experimental theoretical comparisons is R404a, due to its good thermodynamic properties for heat transfer, making it efficient in refrigeration and air conditioning applications. R404a has low toxicity and is non-flammable; it is considered safe for use in closed systems; it operates in pressure ranges compatible with many heat exchanger designs, facilitating control and safety; it is compatible with materials commonly used in industrial refrigeration systems; and it is efficient in applications requiring low temperatures.

Figure 1

(1.a – 1.d) above are part of the IFHPE design project, reported through reference [1]. They represent the staggered configuration of the thermosiphons, the dimensions, the thermosiphon regions and the fins

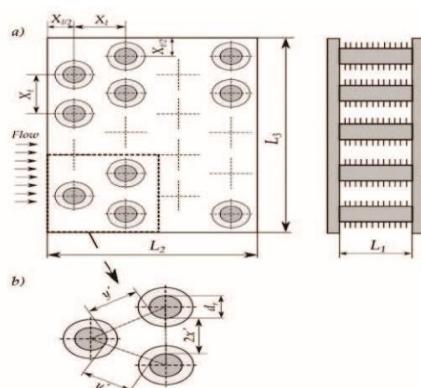


Figure 1.a

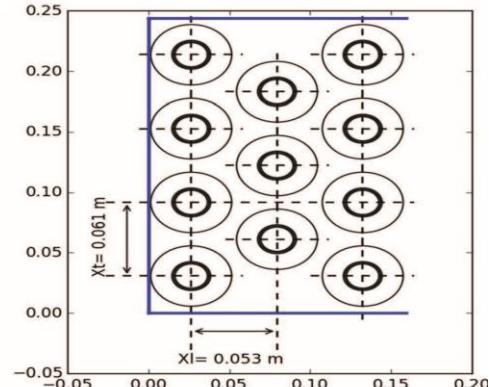


Figure 1.b

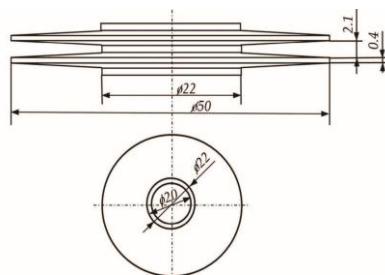


Figure 1.c



Figure 1.d

Figure 2

Initial proposal for AFHPHE

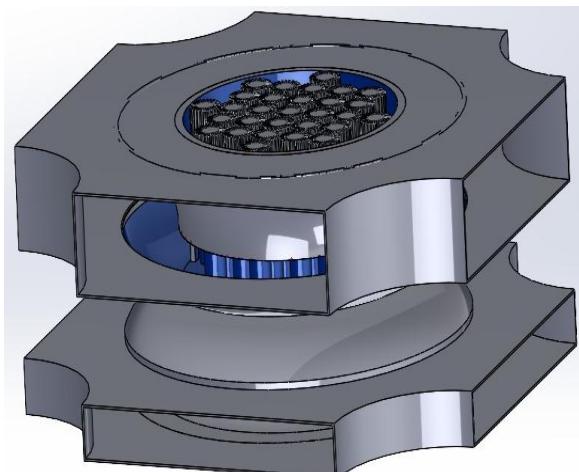


Figure 2 above represents the initial design of the AFHPHE, with the evaporator region, the adiabatic region, the condenser region and the 4 air outlet areas per region [2].

The analysis was divided into three aspects and regions of the device: evaporator, condenser, and heat exchanger. The analysis related to the evaporator is more complete and includes all the essential parameters so that the comparisons between the heat exchangers could be as complete as possible. The analyses related to the condenser and FHPHE present only the essential parameters so that a global analysis of the heat exchangers could be successfully concluded.

The saturation temperatures of the working fluid and inlets, in both heat exchangers, are the same.

$$T_{sat} = 17.0 \text{ } ^\circ\text{C}; T_{Evin} = 30.0 \text{ } ^\circ\text{C}; T_{Cdin} = 10.0 \text{ } ^\circ\text{C} \quad (01)$$

The mass flow rates in the evaporator and condenser are within the range specified below.

$$0.12 \frac{\text{kg}}{\text{s}} \leq \dot{m}_{air} \leq 0.20 \frac{\text{kg}}{\text{s}} \quad (02)$$

The number of heat pipes and the number of fins per heat pipe are defined by the expressions below.

$$N_{HP} = 49 \text{ default}; N_{Fin} = 30 \text{ default} \quad (03)$$

Where: by AFHPHE:

$$N_R = \sqrt{N_{HPb}}, \quad N_{HPb} = 16 \text{ heat pipes} \quad (04)$$

$$N_{HPR} = N_R + (N_R + 1.0) \quad (05)$$

N_{HPR} is the number of heat pipes per row.

Finally, the number of heat pipes is represented by equation (06).

$$N_{HP} = N_{HPR} * (N_R + 1.0) + N_R \quad (06)$$

The tubes and fins are made of aluminum, and the thermal conductivity adopted is represented by the expression below.



$$k_w = 235 \frac{W}{m K} \quad (07)$$

The internal and external diameters are different for both heat exchangers.

$$D_{int} = 50.08 \text{ mm}; D_{ext} = 50.973 \text{ mm}; D_{int} = 20.0 \text{ mm}; D_{ext} = 22.0 \text{ mm} \quad (08)$$

The lengths associated with the evaporator and condenser are different for both heat exchangers.

$$L_{ev} = 220.0 \text{ mm}; L_{cd} = 120.0 \text{ mm}; L_{ev} = 250.0 \text{ mm}; L_{cd} = 250.0 \text{ mm} \quad (09)$$

The fin thickness and fin height are defined by the expressions below.

$$T_{Fin} = 4.0 \text{ mm}; \Delta H_{Fin} = 18.0 \text{ mm}; T_{Fin} = 0.8 \text{ mm} \quad (10)$$

The space between fins is obtained using the following expressions:

$$Sp_{Fin} = (P_{HP} - N_{Fin} * T_{Fin}) / (N_{Fin} + 1.0); Sp_{Fin} = 2.5 \text{ mm by definition} \quad (11)$$

Where:

$$P_{HP} = \pi D_{ext} \quad (12)$$

The shell diameter and channel width are expressed using the formulas below.

$$D_{Shell} = 9.0 * (D_{ext} + 2 * \Delta H_{Fin}) \text{ mm}; W_{HE} = 200.0 \text{ mm by definition} \quad (13)$$

The air intake area is expressed by:

$$A_{air} = \frac{\pi D_{Shell}^2}{4} \quad (14)$$

The air passage area is obtained using the following expression:

$$A_{sec_{air}} = A_{air} - \left(NHP \frac{\pi D_{ext}^2}{4} \right) - (N_{tot_{Fin}} * \Delta H_{Fin} * T_{Fin}) \quad (15)$$

$$A_{sec_{air}} = \frac{\dot{m}_{air} D h_{Ev}}{Re_{air} \mu_{air}} \quad (16)$$

Where:

$$N_{tot_{Fin}} = NHP * N_{Fin} \quad (17)$$

2.1 EQUATIONS FOR EVAPORATOR

The hydraulic diameter in the evaporator is expressed by:

$$Dh_{Ev} = 4 * \frac{A_{sec_{air}}}{Ph_{Ev}}; \quad Dh_{Ev} = \frac{4 * W_{HE}}{2 * (W_{HE} + LEv_{effec})} \quad (18)$$

Where:

$$Ph_{Ev} = NHP * P_{HP} + N_{tot_{Fin}} * (2 * \Delta H_{Fin} + T_{Fin}); \quad LEv_{effec} \\ = L_{Ev} - N_{Fin} * (T_{Fin} + Sp_{Fin}) \quad (19)$$

The heat exchange area between the fluids in the evaporator depends on two areas, namely:

$$A_{TotalEv} = Attr_{Fin} + Attr_{NHP} \quad (20)$$

Where:

$$Attr_{Fin} = L_{Ev} * NHP * (2 * \Delta H_{Fin} + T_{Fin}); \quad Attr_{Fin} \\ = \frac{N_{Fin} * NHP * \pi * (D_{extFin}^2 - D_{intFin}^2)}{4} \quad (21)$$

The boiling coefficient is obtained through the Gupta and Varshney correlation [10], for both heat exchangers.

$$h_{boil} = 1.39 * \left(\frac{k_{water}}{l_*} \right) * \left[Heat_{Flux} * \rho_{water} * Cp_{water} * \frac{l_*}{\rho_l * h_{lv} * k_{water}} \right]^{0.7} \\ * \left(\frac{\rho_l}{\rho_v} \right)^{0.21} \\ * \left(\mu_{water} * \frac{Cp_{water}}{k_{water}} \right)^{-0.21} \quad (22)$$

Heat flux is determined from the Pioro correlation [11;12]):

$$Heat_{flux} = \mu_{Water} * h_{lv} * l_* * \left[\left(\frac{1.0}{C_{sf}} \right)^{0.33} * Pr_{Water}^{\left(\frac{1.0}{0.33} \right)} * \left(Cp_{Water} * \frac{\Delta T_{Evsat}}{h_{lv}} \right)^{\left(\frac{1}{0.33} \right)} \right] \quad (23)$$

Where:

$$l_* = \left[\frac{\sigma_{Water}}{g * (\rho_l - \rho_v)} \right]^{\left(\frac{1}{2} \right)} \quad (24)$$

The saturation temperature difference across the evaporator is represented by equation (25).

$$\Delta T_{Evsat} = T_{airin} - T_{sat} \quad (25)$$

The Nusselt number associated with air is represented by equations below.

$$Nu_{airEv} = 0.696 * Re_{AirEv}^{0.5} * Pr_{air}^{0.36} * \left(\frac{Pr_{air}}{5.0 * Pr_{air}} \right)^{0.25} \quad (26)$$

$$Nu_{airEv} = 0.1387 Re_{dr}^{0.718} Pr_{air}^{(1/3)} \left(\frac{Sp_{Fin}}{D_{extFin} - D_{intFin}} \right)^{0.296} \quad (27)$$

Where:

$$D_{extFin} = 50.0 \text{ mm} \text{ and } D_{intFin} = D_{ext} \quad (28)$$

and,

$$Re_{AirEv} = \frac{4.0 * \dot{m}_{air}}{\pi * D_{hEv} * \mu_{air}}; Re_{dr} = \frac{V_{airmax}}{v_{air}}; Sp_{Fin} = 2.5 \text{ mm by definition} \quad (29)$$

The heat transfer coefficient by air convection in the evaporator is obtained by:

$$h_{Ev} = Nu_{airEv} * \frac{k_{air}}{D_{ext}} \quad (30)$$

The application of the concept of “Aleta Analogy”, conceived by Fakheri [8] leads us to define the following parameters:

$$mL_{EvFin} = \sqrt{\frac{2h_{Ev}}{k_{Fin}t_{Fin}}} P_{hEv} \quad (31)$$

$$\eta_{EvFin} = \frac{\tanh(mL_{EvFin})}{mL_{EvFin}} \quad (32)$$

The fin efficiency for the evaporator section is defined through Equation (32) by η_{EvFin} [8;9]. This quantity is fundamental in theoretical and experimental studies on the thermal performance of fins and is widely used in finned systems analyzed by Élcio Nogueira [13].

$$\beta_{Ev} = \frac{A_{trFin}}{A_{totEv}} \quad (33)$$

$$\eta'_{EvFin} = \beta_{Ev}\eta_{EvFin} + (1 - \beta_{Ev}) \quad (34)$$

The global heat transfer coefficient associated with air in the Evaporator, Uo_{Ev} , is given by equation (35).

$$Uo_{Ev} = \frac{1}{\frac{1}{h_{boil}} + \frac{D_{ext} - D_{int}}{kW} + \frac{1}{\eta'_{EvFin} h_{Evair}}} \quad (35)$$

The heat capacity of the air in the Evaporator is given by C_{Air} .

$$C_{Air} = \dot{m}_{air} C_{p,air} \quad (36)$$

The number of thermal units associated with air in the evaporator, NTU_{Ev} , is given by Equation (37).

$$NTU_{Ev} = \frac{Uo_{Ev} A_{totEv}}{C_{Ev}}, \text{ where } C_{Ev} = C_{Air} \quad (37)$$

The dimensionless number, called "fin analogy," Fa_{Ev} is represented by Equation (35) as defined by Ahamad Fakheri [8] and reported by Nogueira, É. [9].

$$Fa_{Ev} = \frac{NTU_{Ev}}{2.0} \text{ for parallel flow} \quad (38)$$

The thermal efficiency associated with the evaporator is η_{TEv} [8;9].

$$\eta_{TEv} = \frac{\tanh(Fa_{Ev})}{Fa_{Ev}} \quad (39)$$

$$\varepsilon_{TEv} = \frac{1}{\frac{1}{\eta_{tEv} NTU_{Ev}} + \frac{1}{2}} \quad (40)$$

The thermal effectiveness associated with the heat evaporator is ε_{TEv} .

The heat transfer rate between the air and the heat pipe in the evaporating region \dot{Q}_{Ev} is given by the Equation (41).

$$\dot{Q}_{Ev} = \frac{C_{Ev} \Delta T_{Evsat}}{\frac{1}{\eta_{TEv} NTU_{Ev}} + \frac{1}{2}} \quad (41)$$

After passing through the evaporator, the outlet air temperature is represented through Equation below.

$$T_{airout} = T_{airin} - \frac{\dot{Q}_{Ev}}{C_{Ev}} \quad (42)$$

$$Irrev_{TEv} = \log \left(\frac{T_{airin}}{T_{airout}} \right) \quad (43)$$

$Irrev_{TEv}$ is the thermal irreversibility in the evaporator.

The rate of thermal entropy generation is represented by $\dot{S}_{gen_{TEv}}$.

$$\dot{S}_{gen_{TEv}} = Irrev_{TEv} * C_{Ev} \quad (44)$$

The pressure drops across the evaporator is represented by equation (45).

$$\Delta p_{Ev} = Fric_{Ev} * \left(\frac{L_{Ev}}{D_{hEv}} \right) * \left(\frac{\rho_{Air} * V_{AirEv}^2}{2} \right); \Delta p_{Ev} = 2f_{Ev} N_{rows} \rho_{air} V_{airmax} \quad (45)$$

Where:

$Fric_{Ev}$ and f_{Ev} are the frictions factor in the evaporator.

$$Fric_{Ev} = \frac{0.31}{Re_{AirEv}^{0.25}}, \quad f_{Ev} = 0.7465 Re_{dr}^{(-0.316)} \left(\frac{X_t}{dr}\right)^{(-0.927)} \quad (46)$$

$$X_t = Dext_{Fin} \quad (47)$$

Viscous irreversibility in the evaporator is obtained using equation below.

$$Irrev_{VEv} = \log \left(\frac{P_{2Ev}}{P_{1Ev}} \right) \quad (48)$$

Where:

$$P_{1Ev} = P_{2Ev} + \Delta p_{Ev} \quad \text{and} \quad P_{2Ev} = P_{atm} \quad (49)$$

The rate of viscous entropy generation is represented by equation (47).

$$\dot{S}gen_{VEv} = Irrev_{VEv} * C_{Ev} \quad (50)$$

The Bejan number [14] in the evaporator is represented by equation (51).

$$Be_{Ev} = \frac{\dot{S}gen_{TEv}}{\dot{S}gen_{TEv} + \dot{S}gen_{VEv}} \quad (51)$$

2.2 EQUATIONS FOR CONDENSER

The heat exchange area of the heat pipes in the condenser is represented by equation (52).

$$A_{trCd} = L_{Cond} * N_{HP} * (P_{HP} - N_{Fin} * T_{Fin}) \quad (52)$$

The heat exchange area in the condenser is represented by equation (53).

$$A_{totCd} = A_{trFin} + A_{trCd} \quad (53)$$

The Reynolds number associated with the air flow inside the condenser is represented by equation (54).

$$Re_{AirCd} = \frac{4.0 * \dot{m}_{air}}{\pi * D_{hCd} * \mu_{air}} \quad (54)$$

The air velocity inside the condenser is represented by equation (52).

$$V_{AirCd} = \frac{Re_{AirCd} * \mu_{air}}{D_{hCd}} \quad (55)$$

$$Dh_{Cd} = 4 * \frac{Asec_{air}}{Ph_{Cd}}; \quad Dh_{Cd} = \frac{4WHELCd_{effec}}{2(WHE + LCd_{effec})} \quad (56)$$

$$\begin{aligned} Ph_{Cd} &= NHP * P_{HP} + Ntot_{Fin} * (2 * \Delta H_{Fin} + T_{Fin}); \quad LCd_{defffec} \\ &= L_{Cd} - N_{Fin} * (T_{Fin} + Sp_{Fin}) \quad (57) \end{aligned}$$

The saturation temperature difference across the condenser is represented by equation (58).

$$\Delta T_{Cdsat} = T_{sat} - T_{airin} \quad (58)$$

The condensation coefficient in the condenser is represented by equation (59).

$$h_{Cond} = 0.943 * \left[\frac{\rho_l * (\rho_l - \rho_v) * h_{lv} * g * k_{water} ** 3}{\mu_{awter} * L_{Cd} * \Delta T_{Cdsat}} \right]^{\frac{1}{4}} \quad (59)$$

The Nusselt number associated with the air in the condenser is represented by equation (60).

$$\begin{aligned} Nu_{airCd} &= 0.696 * Re_{AirCd}^{0.5} * Pr_{air}^{0.36} * \left(\frac{Pr_{air}}{5.0 * Pr_{air}} \right)^{0.25}; \\ Nu_{airCd} &= 0.1387 Re_{dr}^{0.718} Pr_{air}^{(\frac{1}{3})} \left(\frac{Sp_{Fin}}{Dext_{Fin} - Dint_{Fin}} \right)^{0.296} \quad (60) \end{aligned}$$

The condensation transfer coefficient in the heat pipe is provided by h_{Cond} , as reported in [9].

$$h_{Cd} = Nu_{airCd} * \frac{k_{air}}{Dext} \quad (61)$$

The application of the concept of “Aleta Analogy”, conceived by Fakheri [8] leads us to define the following parameters:



$$mL_{CdFin} = \sqrt{\frac{2h_{Cd}}{k_{Fin}t_{Fin}}} P_{hCd} \quad (62)$$

$$\eta_{CdFin} = \frac{\text{Tanh}(mL_{CdFin})}{mL_{CdFin}} \quad (63)$$

The fin efficiency for the condenser section is defined through Equation (63) by η_{CdFin} .

$$\beta_{Cd} = \frac{A_{trFin}}{A_{totCd}} \quad (64)$$

$$\eta'_{CdFin} = \beta_{Cd}\eta_{CdFin} + (1 - \beta_{Cd}) \quad (65)$$

The efficiency associated with the set of fins in the condenser, weighted by the area of change of the fins η'_{CdFin} , is represented through Equation (65).

$$Uo_{Cd} = \frac{1}{\frac{1}{h_{cond}} + \frac{D_{ext} - D_{int}}{kW} + \frac{1}{\eta'_{CdFin} h_{Cd}}} \quad (66)$$

The global heat transfer coefficient associated with air in the condenser, Uo_{Cd} , is given by Equation (66).

$$C_{Air} = \dot{m}_{air} C_{p,air} \quad (67)$$

The heat capacity of the air in the condenser, C_{Air} , is given by Equation (67).

$$C_{Cd} = C_{Air} \quad (68)$$

$$NTU_{Cd} = \frac{Uo_{Cd} * A_{totCd}}{C_{Cd}} \quad (69)$$

The number of thermal units associated with air in the condenser, NTU_{Cd} , is given by Equation (69).

$$Fa_{Cd} = \frac{NTU_{Cd}}{2.0} \text{ for counterflow} \quad (70)$$

The dimensionless number, called "fin analogy," Fa_{Cd} is represented by Equation (70) as defined by Ahamad Fakheri [8] and reported by Nogueira, É. [9].

$$\eta_{TCD} = \frac{\tanh(Fa_{Cd})}{Fa_{Cd}} \quad (71)$$

The thermal efficiency associated with the condenser is η_{TCD} .

$$\varepsilon_{TCD} = \frac{1}{\frac{1}{\eta_{TCD} NTU_{Cd}} + \frac{1}{2}} \quad (72)$$

The thermal effectiveness associated with the condenser is ε_{TCD} .

$$\dot{Q}_{Cd} = \frac{C_{Cd} \Delta T_{Evsat}}{\frac{1}{\eta_{TCD} NTU_{Cd}} + \frac{1}{2}} \quad (73)$$

The heat transfer rate between the air and the heat pipe in the condenser region \dot{Q}_{Cd} is given by the Equation (73).

$$T_{airout} = \frac{\dot{Q}_{Cd}}{C_{Cd}} + T_{airin} \quad (74)$$

After passing through the condenser (heat recover), the outlet air temperature is represented through Equation (74).

Thermal irreversibility in the condenser is obtained using equation (75) below.

$$Irrev_{TCD} = \log \left(\frac{T_{airin}}{T_{airout}} \right) \quad (75)$$

The rate of thermal entropy generation in the condenser is represented by equation (76).

$$\dot{S}_{gen_{TCD}} = Irrev_{TCD} * C_{Cd} \quad (76)$$

$$Fric_{Cd} = \frac{0.31}{Re_{AirCd}^{0.25}}, f_{Cd} = 0.7465 Re_{dr}^{(-0.316)} \left(\frac{X_t}{dr} \right)^{(-0.927)} \quad (77)$$

The friction factor in the condenser is represented by equation (77).

$$\Delta p_{cd} = Fric_{cd} * \left(\frac{L_{cd}}{D_{hcd}} \right) * \left(\frac{\rho_{Air} * V_{AirCd}^2}{2} \right); \Delta p_{cd} = 2f_{cd} N_{rows} \rho_{air} V_{air_{max}} \quad (78)$$

The pressure drops across the condenser is represented by equation (78).

The pressure at the evaporator inlet is represented by equation (79).

$$P_{1cd} = P_{2cd} + \Delta p_{cd} \quad (79)$$

By definition:

$$P_{2cd} = P_{atm} \quad (80)$$

Viscous irreversibility in the condenser is obtained using equation (81) below.

$$Irrev_{Vcd} = \log \left(\frac{P_{2cd}}{P_{1cd}} \right) \quad (81)$$

The rate of viscous entropy generation in the condenser is represented by equation (82).

$$\dot{S}gen_{Vcd} = Irrev_{Vcd} * C_{cd} \quad (82)$$

The Bejan number in the capacitor is represented by equation (83).

$$Be_{cd} = \frac{\dot{S}gen_{Tcd}}{\dot{S}gen_{Tcd} + \dot{S}gen_{cd}} \quad (83)$$

2.3 EQUATIONS FOR FINNED HEAT PIPE HEAT EXCHANGER – FHPHE

O método teórico para obtenção das equações abaixo, válidas para o trocador de calor, denominado de método localizado, utiliza os valores obtidos individualmente no evaporador e condensador, conforme procedimento preconizado nas referências [6;7].

$$\dot{Q}_{FHPHE} = \dot{Q}_{Ev} + \dot{Q}_{cd} \quad (84)$$

$$\dot{Q}_{Max} = C_{min}(T_{Evin} - T_{cdout}) \quad (85)$$

$$\varepsilon_{IFHPHE} = \frac{\dot{Q}_{IFHPHE}}{\dot{Q}_{Max}} \quad (86)$$

$$\Delta p_{IFHPHE} = \Delta p_{Ev} + \Delta p_{Cd} \quad (87)$$

$$\sigma_{THPHE} = \sigma_{TEv} + \sigma_{TCd} \quad (88)$$

$$\sigma_{fHPHE} = \sigma_{fEv} + \sigma_{fCd} \quad (89)$$

$$Be_{HPHE} = \frac{\sigma_{THPHE}}{\sigma_{THPHE} + \sigma_{fHPHE}} \quad (90)$$

Be_{HPHE} is the thermodynamic Bejan number associated with the heat exchanger.

3 RESULTS AND DISCUSSION

This section presents results obtained through theoretical simulations and discusses their relevance. The main objective is to compare the thermal and viscous performances of the heat exchangers under analysis.

Comparisons are made for results in the evaporator, condenser, and heat exchanger. The overall results obtained for the heat exchangers demonstrate that the localized analysis is consistent, since theoretical results can be compared with experimental results obtained for the IFHPHE.

The standard parameters for both heat exchangers under analysis are saturation temperature of the working fluid (R404a) equal to 17.0 °C; mass flow rate variation between 0.12 kg/s and 0.20 kg/s; number of fins equal to 30; inlet temperatures in the evaporator and condenser equal to 30.0 °C and 10.0 °C, respectively. In some situations, presented, the number of fins is defined as equal to 70 fins for the IFHPHE, with the objective of comparing performance in relation to the number of 30 fins.

3.1 EVAPORATOR

Figure 3 shows velocity values as a function of air mass flow rate in the evaporator. The air velocity for the IFHPHE is approximately twice that of the AFHPHE. The difference in velocities can be justified by the configuration of the heat exchangers, since the IFHPHE has a staggered configuration and crossflow with the air, that is, perpendicular to the direction of the air, creating a barrier to it. In the case of the AFHPHE, the air enters the evaporator in the direction of the heat pipes, and the only barrier it encounters are the frontal areas of the pipes and fins. Although the AFHPHE has heat pipes with approximately twice the diameter, the air passage area is larger, resulting in lower velocity. When the number of fins is reduced from 30 to 0 (zero) in the IFHPHE, the velocity drops sharply, demonstrating the influence of the fins on the heat exchanger's performance. Featured are the 49 finned thermosiphons in a diametrically symmetrical configuration. This design allows for homogeneous air distribution within the heat pipe, contributing to less viscous heat dissipation.

Figure 4 presents result for the Nusselt number. Since the Nusselt number strongly depends on the Reynolds number, it is expected that IFHPHE will show a higher value for the Nusselt number compared to AFHPHE. The relationship between the Nusselt numbers is almost the same as that presented by the velocities, approximately double.

Figure 3

Air velocity in the evaporator

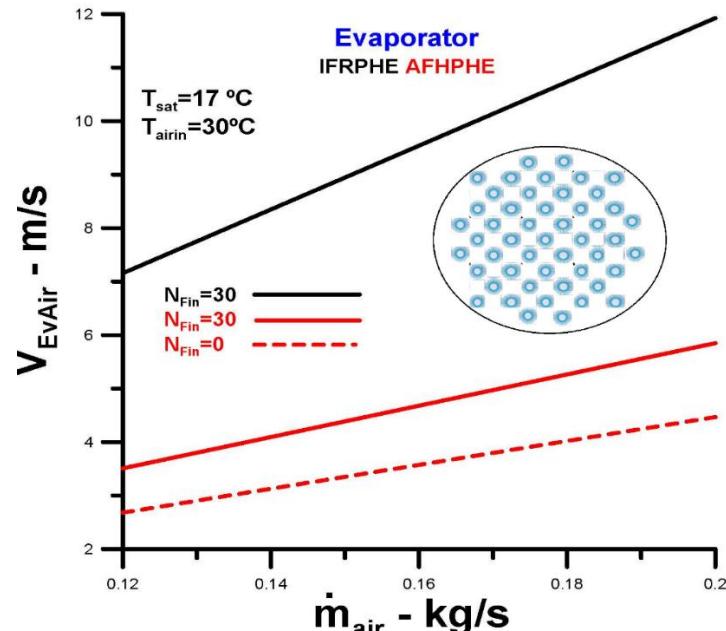


Figure 4

Nusselt number in the evaporator

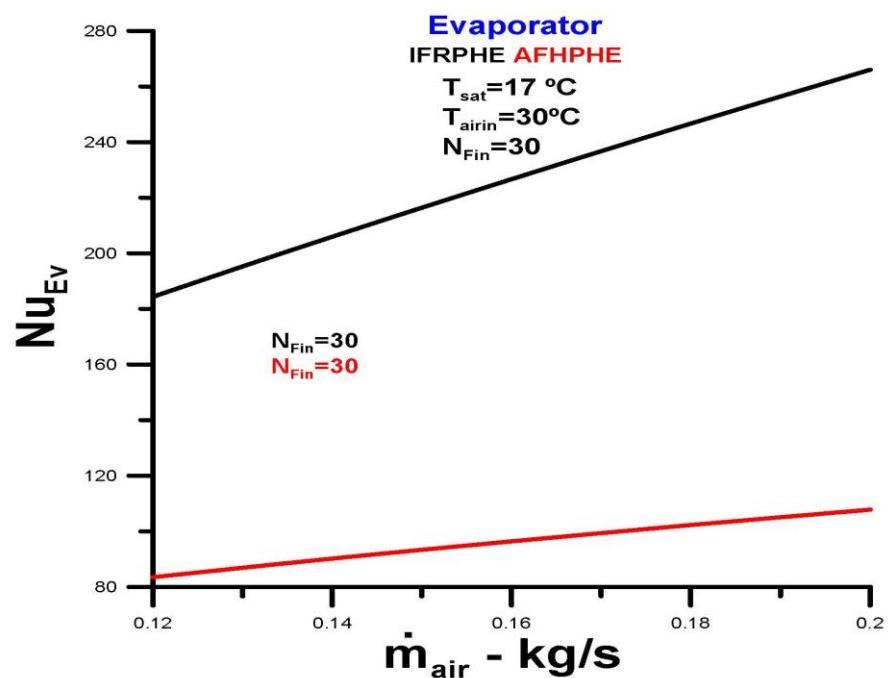


Figure 5 presents result for the heat exchange areas. The heat exchange area of the IFHPHE is smaller than the heat exchange area of the AFHPHE despite having a greater length. The difference in this case is the diameter of the heat pipes, which is almost double the value. Even with a fin count of 70, the difference is significant and should be reflected in the thermal performance of both heat exchangers.

Figure 5

Heat exchange area


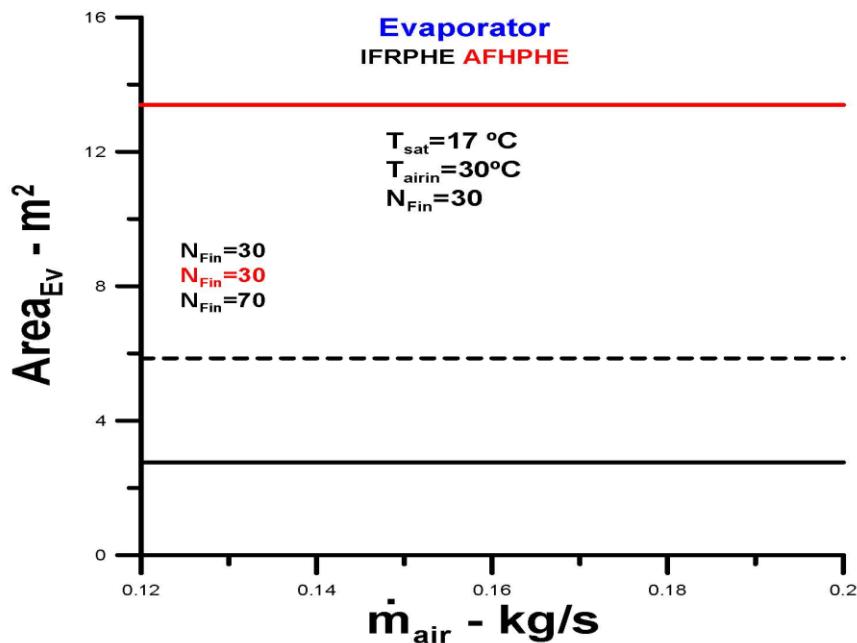



Figure 6

Number of thermal unit - NTU

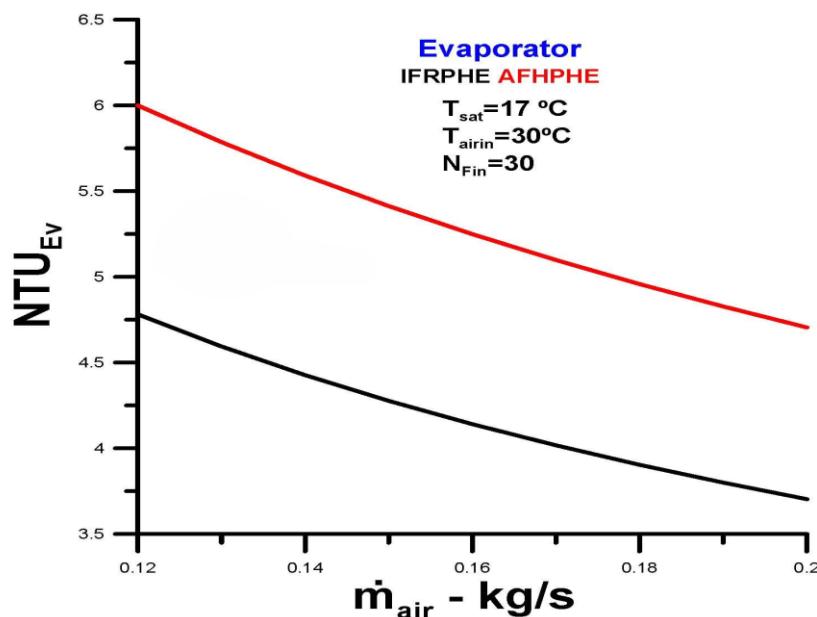

The number of thermal units (NTU) of the AFHPHE, represented in Figure 6, surpasses the value obtained for the IFHPHE. This result can be explained by the larger heat exchange area of the AFHPHE. It is important to emphasize that although the Nusselt number is higher in the case of the IFHPHE, which reflects a higher value for the convection heat transfer coefficient, the predominant factor in determining the overall coefficient is the boiling coefficient, and this parameter is the same for both heat exchangers.

Figura 7
Effectiveness

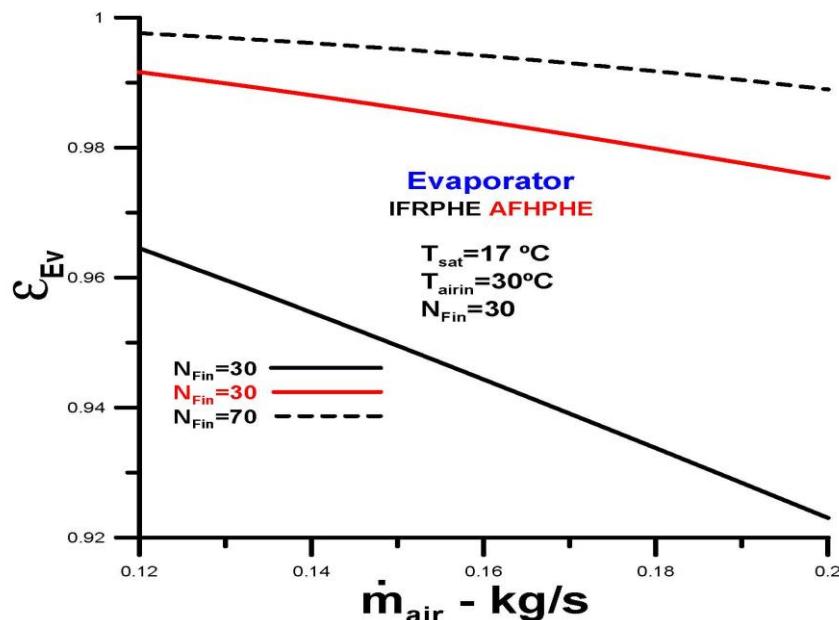

Values for effectiveness are represented in Figure 7. The values reflect what has already been evaluated and support the findings. The AFTHE has higher thermal effectiveness than the IFHPE when using 30 fins. However, the values presented for IFHPHE, in absolute terms, are not very different. It can be stated that in thermal terms there is no significant difference, and this result should be reflected in the outlet temperatures. For comparison, analyzing the influence of the number of fins on the heat exchange area, it is found that the value presented for 70 fins in the IFHPHE is slightly higher than the value obtained by the AFTHE for 30 fins. There is no significant difference, once again, between the absolute values. However, the values demonstrate exceptional thermal performance for the AFTHE.

Outlet temperatures for both heat exchangers are shown in Figure 8. The results reflect and corroborate the evidence obtained and discussed previously. The outlet temperature of the air in the evaporator is lower for the AFHPHE compared to the IFHPHE for 30 fins. The difference increases with increasing flow rate, reflecting the observed values for thermal

efficiency. When evaluating the influence of the number of fins, imposing 70 fins per heat pipe in the IFHPHE, a lower temperature value per flow rate is observed, as expected. Excellent thermal performance.

Figure 8

Outlet temperature

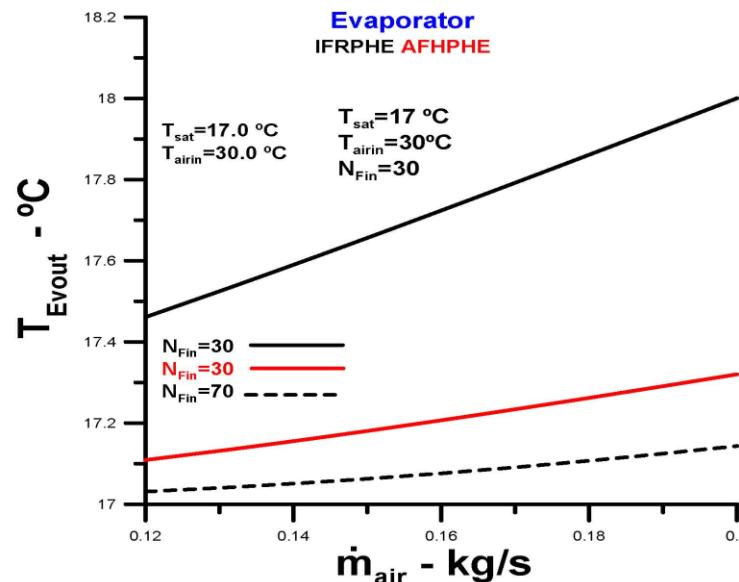


Figure 9

Drop in pressure

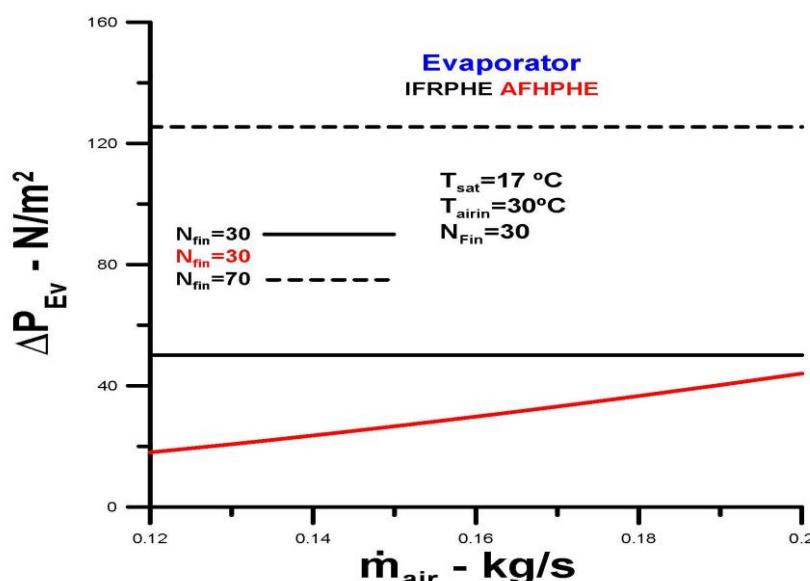



Figure 9 presents result from the pressure drop in the evaporator. The pressure drop in the evaporator is lower for the AFTHE heat exchanger with 30 fins. This result reflects a lower evaporator velocity. The difference decreases with increasing flow rate. For an upper

limit value of 0.20 kg/s, the pressure drops become closer, but the loss in the AFTHE is still lower. The higher-pressure drop observed by 70 fins in the IFHPHE reflects the greater number of fins. However, it should be noted that the pressured drop obtained for the AFTHE is only in the internal flow between the heat pipes and the shell. Pressure drop at the heat exchange outlet was not implemented, as this aspect is still under study and analysis. This important aspect will be discussed further in the analysis ahead and in the conclusion.

The Bejan number in the evaporator is represented in Figure 10. The Bejan number reflects the relative influence of viscous irreversibility on the overall performance of the heat exchanger. The weight of viscous irreversibilities in the IFHPHE is high and influences the low relative value of the Bejan number. In terms of viscous performance in the evaporator, the IFHPHE with 70 fins is poor, negating its excellent thermal performance and excluding it as an option. For 30 fins, the viscous performance of the IFHPHE is quite reasonable and outperforms most conventional heat exchangers. In the case of the IFHPHE, two simulations were implemented, simulating a pressure loss associated with the air outlet in the evaporator. Two pressure drop amplification factors shown in Figure 7 were added to Figure 8, 50% and 100% higher. When the 100% factor is imposed, there is an equality of viscous performance between the heat exchangers, for the maximum flow rate under analysis. For a 50% condition, the performance is exceptional.

Figure 10

Bejan Number

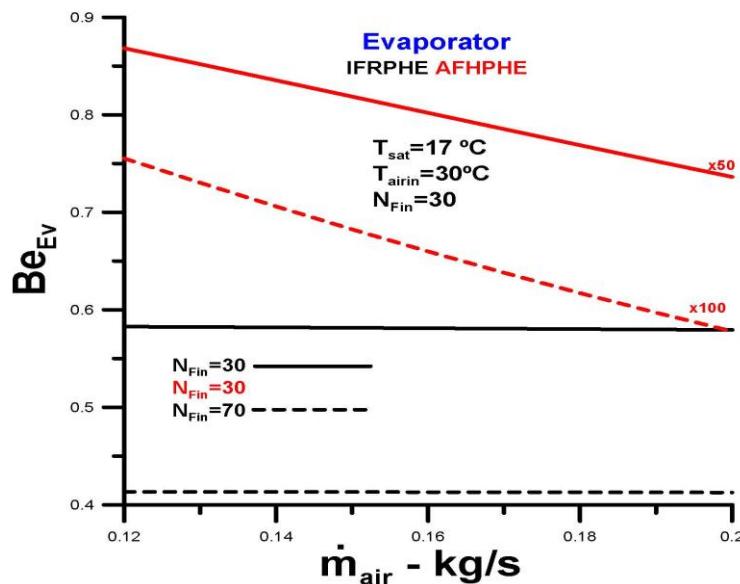

3.2 CONDENSER

In this section, we begin the analysis and evaluation of the results obtained for the condenser region for both heat exchangers.

Only parameters relevant to objectively assessing the condenser thermal and viscous performance were analyzed, as some overlap with those of the evaporator.

The effectiveness in the condenser is represented in Figure 11. The effectiveness of the AFHPHE is exceptional for 30 fins, due to its larger heat exchange area. Superior thermal performance, compared to the evaporator, is achieved due to the counterflow arrangement. The effectiveness of the IFHPHE remains in a range of 0.45 to 0.66, for 30 fins. In the case of 70 fins for the IFHPHE, the efficiencies are similar, with lower performance for higher flow rates. These results, as previously evidenced, are crucial for the overall performance analysis of the heat exchangers.

Figure 12 reflects the results obtained for thermal effectiveness, with temperatures close to the saturation temperature of the working fluid in the case of the IFHPHE with 30 fins, across the entire flow rate range analyzed. The temperatures obtained for the IFHPHE are significantly below the saturation temperature of the working fluid for 30 fins, decreasing for higher flow rates. For 70 fins, the temperatures approach the saturation temperature of the working fluid for low flow rates and decrease with increasing flow rate.

Figure 11
Effectiveness

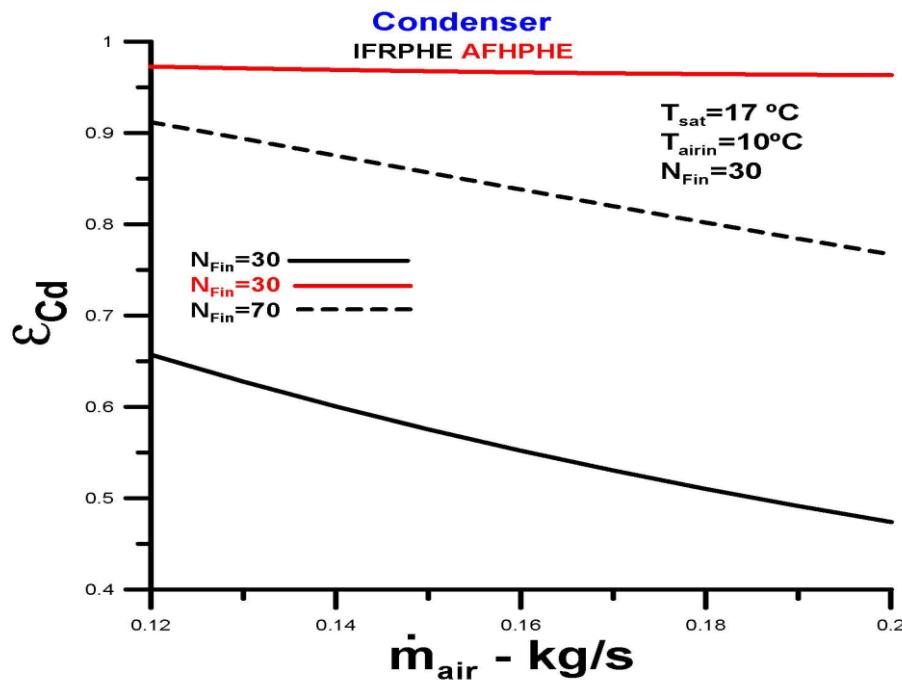


Figure 12

Temperature

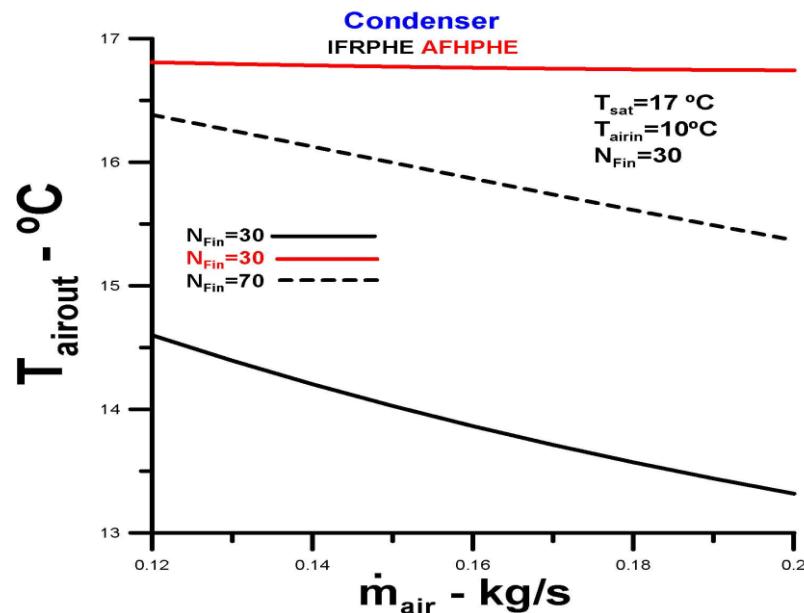


Figure 13

Pressure drops


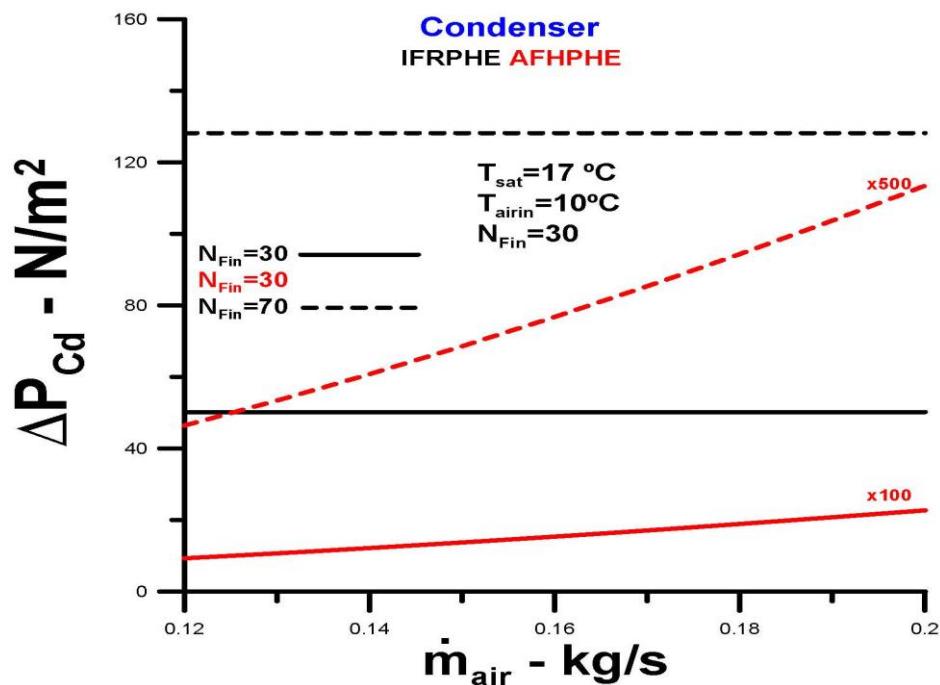


Figure 13 presents result of pressure drop in the condenser. The results obtained reflect what has already been discussed for the evaporator, with a slight drop compared to the IFHPHE, since the evaporator length is twice the length of the condenser. A 100x simulation of the pressure drop in the tubes and shell of the heat exchanger shows that the

pressure drop results are close to the pressure drop of the IFHPHE with 70 fins and maximum flow rate.

Figure 14

Bejan Number

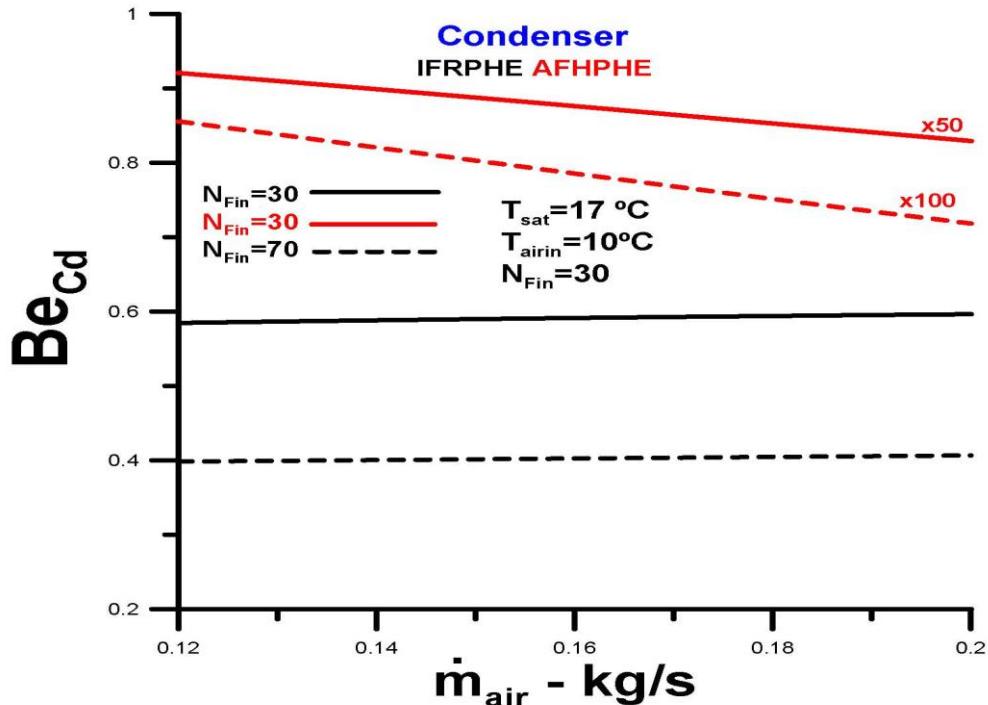

The Bejan number in the evaporator is represented in Figure 14. The results obtained demonstrate a superior overall performance for the AFHPHE compared to the IFHPHE. The performance of the IFHPHE for 70 fins is equal to 40% of the maximum possible performance. Considering the pressure loss value, this result is significant and reflects the exceptional superiority for AFHPHE.

3.3 FHPHE

In this section we present results related to the overall performance of heat exchangers.

Figure 15 presents theoretical and experimental results for thermal effectiveness obtained for IFHPHE and presented through reference [7]. The results are valid for the lowest air flow rate, approximately equal to 0.12 kg/s.

Figure 16 presents theoretical and experimental results obtained for heat transfer rate obtained for IFHPHE and reported through reference [7]. The results are valid for the lowest air flow rate, approximately equal to 0.12 kg/s.

Figure 15

Effectiveness teorico versus experimental [7]


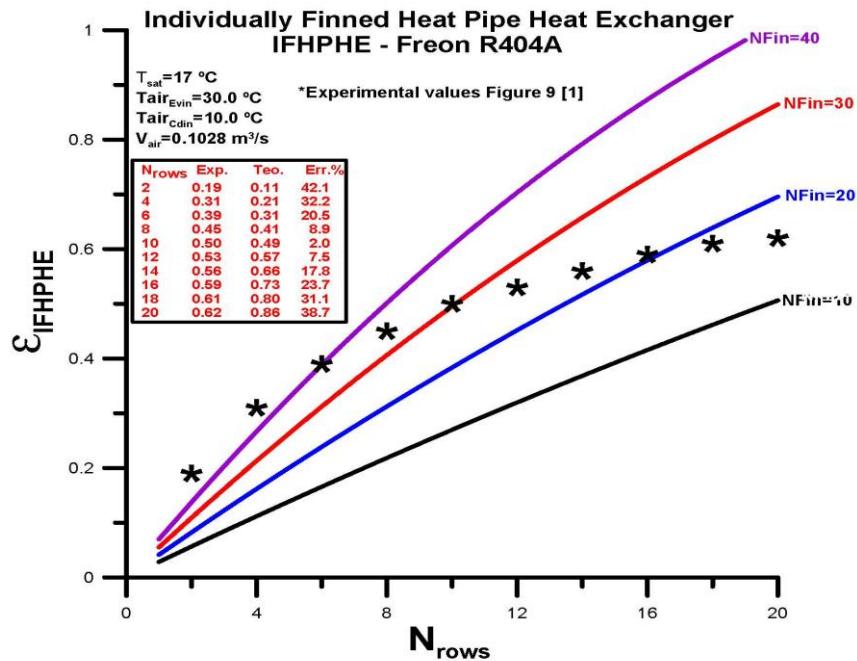


Figure 16

Theoretical and experimental heat transfer rate [7]

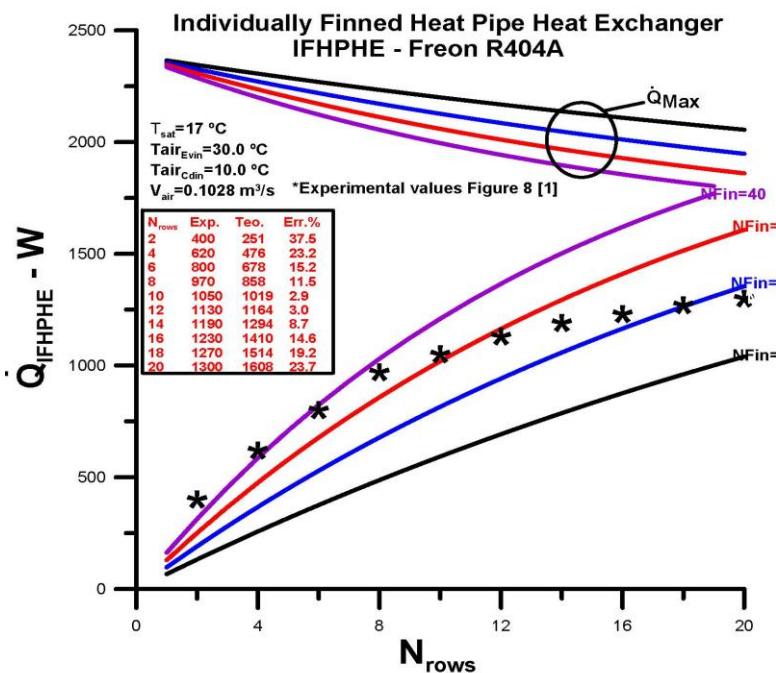

The results for pressure loss presented in Figure 17 were reported in reference [7]. This is a theoretical experimental comparison for the IFHPHE, considering the variation in the number of tubes and the number of fins, for the lowest flow rate, equal to 0.12 kg/s. The

experimental results for 30 fins coincide with the simulated results and demonstrate the consistency of the model developed for the IFHPHE.

Figure 17

Pressure drops in the IFHPHE in relation to the number of fins [7]

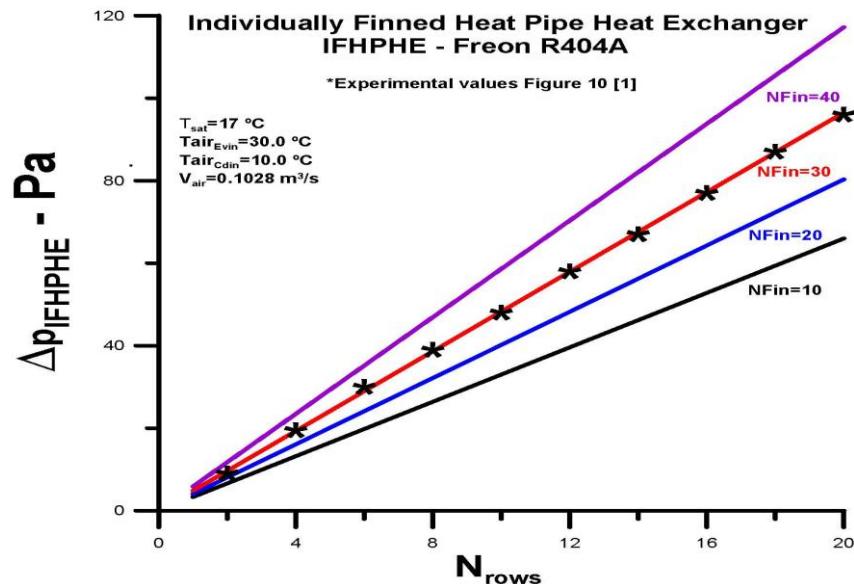


Figure 18 presents result for overall effectiveness of both heat exchangers analyzed. The thermal performance of the AFHPHE is significantly superior to that obtained for the IFHPHE, for 30 fins, across the entire flow range. The thermal performance of the IFPH with 70 fins is slightly superior to that of the AFHPHE, across the entire flow range.

Figure 18

Overall thermal effectiveness for heat exchangers

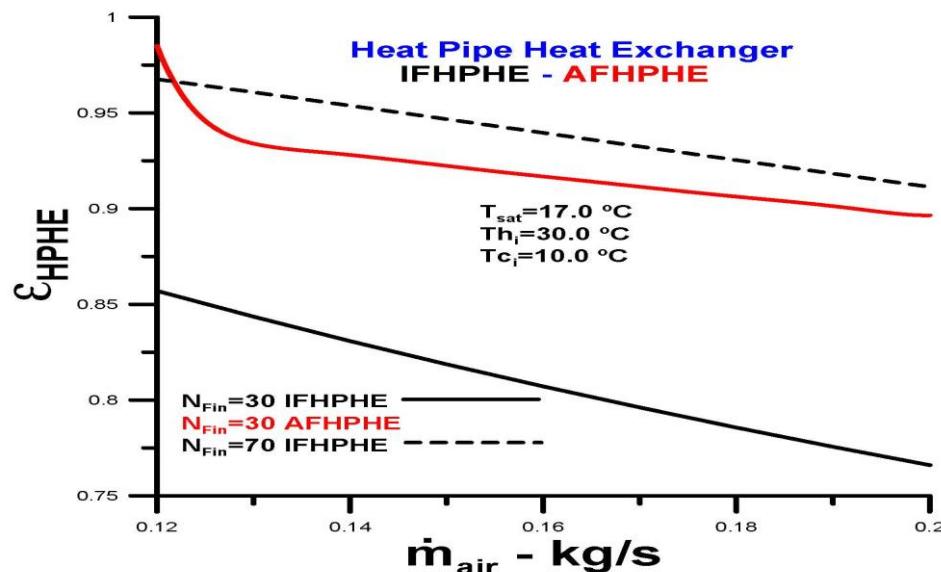


Figure 19

Bejan number for heat exchangers

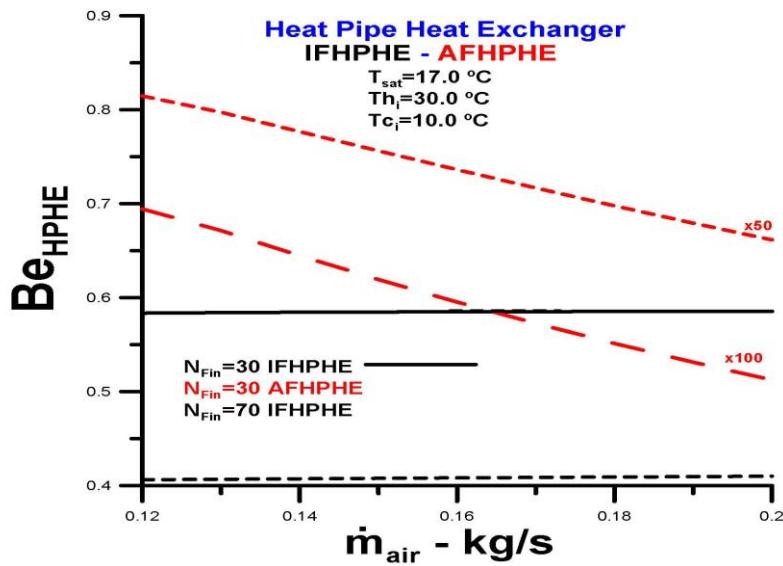


Figure 19 presents results reflecting the overall performance of the heat exchangers, using the Bejan number. The overall performance of the AFHPHE is superior across the entire flow range when the pressure drop corresponds to 50 times the pressure drops in the heat pipes and the shell of the heat exchanger, for the entire flow range and with several fins equal to 30. For a drop corresponding to 100 times the drop in the heat pipes, the performance is superior for low flow rates and slightly inferior for high flow rates. When the number of fins corresponds to 70 in the IFHPHE, the overall performance is very low, not justifying the configuration.

Considerations regarding pressure losses at the air outlets in the evaporator and condenser for the AFHPHE must be explicitly stated in this context, since they were imposed during the simulations, despite being realistic and oversized in relation to the heat exchanger design. These constraints were necessary during the simulation phase because the prototype's outlet design is still in the theoretical and experimental design phase, seeking the lowest possible viscous dissipation. The prototype represented in Figure ... is not feasible, since four air outlets are impractical, despite being a diametrically homogeneous and aesthetically very well-conceived design for the AFHPHE.

4 CONCLUSION

Comparisons are made between two finned tube heat exchangers: an individually finned tube heat exchanger (IFHPHE) and an axially finned tube heat exchanger (AFHPHE).

The comparisons are made locally in the evaporator and condenser, and globally in the heat exchanger.

The fixed parameters used in the comparisons were the mass flow rates of air in the shell, varying from 0.12 kg/s to 0.20 kg/s, the temperature of the working fluid (R404a) $T_{sat} = 17.0\text{ }^{\circ}\text{C}$, the number of fins per heat pipe equal to 30 fins (possibly 70 fins in the IFHPHE, for analysis purposes).

The quantities obtained in the theoretical analysis were velocities, Nusselt numbers, number of thermal units (NTU), thermal effectiveness, outlet temperatures, pressure losses, and Bejan numbers.

The results demonstrate that the heat exchange in the two heat exchangers is high and very close when the number of fins is kept at 30. When 70 fins are imposed for the IFHPHE, the thermal performance is higher than the performance of the AFHPHE for 30 fins and approaches the maximum possible.

Regarding pressure loss, the results presented show significantly different values for the heat exchangers. The pressure losses in the IFHPHE are higher than those obtained for the AFHPHE, and in the case of 70 fins, the difference is extremely high. These differences are justified by the design of the IFHPHE, which features crossflow and a staggered configuration for the tube rows, with a much larger air passage area compared to the AFHPHE.

When analyzing Bejan's figures, which include thermal and viscous performance, the comparisons are very favorable for AFHPHE, with high thermal performance and a relatively low viscous effect compared to IFHPHE. With 30 fins per heat pipe, IFHPHE surpasses most standard heat exchangers. In the case of 70 fins for IFHPHE, despite the extremely high thermal performance, the cost-benefit ratio is not satisfactory, and its implementation should be discarded.

The prototype represented in Figure 2 is not feasible, since four air outlets are impractical, despite being a diametrically homogeneous and aesthetically very well-conceived design for the AFHPHE.

Through the comparisons carried out, the superior overall performance of the AFTHE is demonstrated. However, the ideal configuration for the heat exchanger needs to be finalized so that the conclusions presented can be experimentally validated.

5 NOMENCLATURE

A_{sec} - cross-section area, [m^2]

A_{tr} – heat transfer area, [m^2]



C_p – specific heat, [$\frac{J}{kg\ K}$]

C – thermal capacity, [$\frac{W}{K}$]

C_{\min} – minimum thermal capacity, [$\frac{W}{K}$]

$$C^* = \frac{C_{\min}}{C_{\max}}$$

D_h – hydraulic diameter, [m]

Fa – fin analogy

h – coefficient of heat convection, [$\frac{W}{m^2 K}$]

k – thermal conductivity, [$\frac{W}{m K}$]

K - Kelvin

k_w – thermal conductivity of the tube, [$\frac{W}{m K}$]

k_{Fin} – thermal conductivity of the fin, [$\frac{W}{m K}$]

L – vertical or horizontal length, [m]

\dot{m}_{air} – mass flow rate of the air, [$\frac{kg}{s}$]

N_{Fin} – number of fins

Nu – Nusselt number

Pr – Prandtl number

\dot{Q} – actual heat transfer rate, [W]

\dot{Q}_{\max} – maximum heat transfer rate, [W]

Re – Reynolds number

T – temperatures, [$^{\circ}C$]

U_o – global heat transfer coefficient, [$\frac{W}{m^2 K}$]

Subscripts



boil – ebulação

Cd – Condenser

Cond - Condenser

effect – effective

Ev – Evaporator

ext - external

HP – heat pipe

H - horizontal

in – inlet

int – internal

out – outlet

sat - saturation

Greek symbols

α – thermal diffusivity, $[\frac{m^2}{s}]$

β – the relationship between areas

ρ – density of the fluid, $[\frac{kg}{m^3}]$

μ – dynamic viscosity of fluid, $[\frac{kg}{ms}]$

ν – kinematic viscosity of the cold fluid, $[\frac{m^2}{s}]$

ε_T – thermal effectiveness

η_T – thermal efficiency

ΔT – a difference of temperatures, [°C]

Acronyms

FHPHE – Finned heat pipe heat exchanger

Ev – Evaporators

Cd – Condenser

NHP – Number of Heat Pipes

NFin – Number of Fins

Nrows – Number of rows

NTU – number of thermal units

REFERENCES

- 1 Górecki, G.; Łęcki, M.; Gutkowski, A.N.; Andrzejewski, D.; Warwas, B.; Kowalczyk, M.; Romanik, A (2021). "Experimental and Numerical Study of Heat Pipe Heat Exchanger with Individually Finned Heat Pipes." *Energies* 2021, 14, 5317. <https://doi.org/10.3390/en14175317>
- 2 Nogueira, É., Diniz, F. dos S.F., Felix, R. and Tavares, E.L. de O. (2025). "Evaluation of the Theoretical Design and Mathematical Modeling for Determination of Thermal and Viscous Irreversibilities in Axially Finned Two-Phase Closed Thermosyphon Heat Exchanger." *Journal of Materials Science and Chemical Engineering* (Accepted for publication).
- 3 Nandy Putra, Trisno Anggoro, Adi Winarta (2017). "Experimental Study of Heat Pipe Heat Exchanger in Hospital HVAC System for Energy Conservation." *International Journal of Advance Science Engineering Information Technology*, Vol.7 (2017) No. 3. ISSN: 2088-5334. DOI: 10.18517/ijaseit.7.3.2135.
- 4 Ragil Sukarno, Nandy Putra, Imansyah Ibnu Hakim, Fadhil Fuad Rachman and Teuku Meurah Indra Mahlia (2021). "Multi-Stage Heat-Pipe Heat Exchanger for Improving Energy Efficiency of the HVAC System in a Hospital Operating Room." *International Journal of Low-Carbon Technologies* 2021, 16, 259–267. doi:10.1093/ijlct/ctaa048 Advance Access publication 22 July 2020
- 5 Imansyah Ibnu Hakim, Ragil Sukarno, Nandy Putra (2021). "Utilization of U-Shaped Finned Heat Pipe Heat Exchanger in Energy-Efficient HVAC Systems." *Thermal Science and Engineering Progress*. <https://doi.org/10.1016/j.tsep.2021.100984>
- 6 Élcio Nogueira (2023). "Theoretical thermal performance of crossflow finned heat pipe heat exchanger used for air conditioning in surgery rooms." *Mechanical Engineering Advances* 2023; 1(1): 131.
- 7 Élcio Nogueira (2023). "Thermal and viscous irreversibilities in the heat exchanger of individually finned heat pipes using freon R404A as the working." *Mechanical Engineering Advances* 2023; 1(1): 132.
- 8 Élcio Nogueira (2025). "Heat Exchangers: Analytical Modeling and Applications." Editora Dialética, ISBN: Livro físico: 978-65-270-6139-7 E-book: 978-65-270-6140-3. <https://doi.org/10.48021/978-65-270-6139-7>
- 9 Fakheri, A. (2007). "Heat Exchanger Efficiency." *Transactions of the ASME*, Vol. 129, pp. 1268- 1276. DOI: 10.18488/65.v9i1.313.
- 10 Mohammed Salah Hameed, Abdul Rahman Khan, A. A. Mahdi (2013). "Modeling a General Equation for Pool Boiling Heat Transfer." *Advances in Chemical Engineering and Science*, 3, 294-303. <http://dx.doi.org/10.4236/aces.2013.34037>
- 11 Warren M. Rohsenow (1951). "A Method of Correlating Heat Transfer Data for Surface Boiling of Liquids." Technical Report Nº 5, The Office Naval Research Contract N5ori-07827, Massachusetts Institute of Technology.
- 12 I.L. Pioro, W. Rohsenow, S.S. Doerffer (2004). "Nucleate pool-boiling heat transfer. II: assessment of prediction methods." *International Journal of Heat and Mass Transfer* 47, 5045–5057. doi:10.1016/j.ijheatmasstransfer.2004.06.020
- 13 Nogueira, Elcio. "Analytical and Numerical Methods with Engineering Applications in Heat Transmission and Fluid Mechanics." 1^a. ed. Curitiba: Appris Editora, 2020. v. 1. 201p . ISBN-10 : 8547345167



14 Zimparov, V.D., Angelov, M.S. and Hristov, J.Y. (2021). "Critical Review of the Definitions of the Bejan Number First Law of Thermodynamics." International Communications in Heat and Mass Transfer, 124, Article 105113. <https://doi.org/10.1016/j.icheatmasstransfer.2021.105113>